Bitronics

50 Series SCADA Meters

Modbus Manual

September 8, 2011
ML0037 Document Revision E
© 2011 by Bitronics, LLC

NovaTech®
Bitronics ◆ D/3 ◆ Orion

Copyright 2011 Bitronics LLC

TABLE OF CONTENTS

50 SERIES MANUAL SET **5**

VERSION HISTORY (Abridged) **5**

CERTIFICATION **6**

INSTALLATION AND MAINTENANCE **6**

WARRANTY AND ASSISTANCE **6**

COPYRIGHT NOTICE **7**

TRADEMARKS **7**

SAFETY SECTION **7**

1.0 MODBUS INTERFACE **8**

1.1 Description 8

1.2 Modbus Address 8

1.3 Transaction Timing 8

1.4 Data Format 8

1.4.1 Modbus Calculation-Type Codes 10

1.5 Configuration 13

1.5.1 Setting CT and VT Ratios 13

1.5.2 Resetting Energy and Demands 14

1.5.3 Tag Register 14

1.6 Register Sets and Register Types 14

1.7 Primary Units 14

1.8 Health Check 16

1.9 Heartbeat State Counter 16

1.10 Meter ID Register 16

1.11 Custom Register Lists 16

2.0 MODBUS PROTOCOL **19**

2.1 Introduction 19

Copyright 2011 Bitronics LLC

2.2 MODBUS RTU Message Framing 19

2.3 MODBUS RTU Message Content 19

2.4 MODBUS Function Codes 19

2.5 MODBUS Exception Codes 20

2.6 Supported MODBUS Commands 20

2.6.1 Read Holding Registers (Function Code 03) 21

2.6.2 Preset Single Register (Function Code 06) 22

2.6.3 Preset Multiple Registers (Function Code 16) 22

3.0 MODBUS OVER ETHERNET (TCP) 23

3.0.1 IP Addressing 23

Appendix A Bitronics Legacy Modbus Register Assignments – BiLF12 (Default – 12 bit) 24

Appendix B Bitronics Legacy Modbus Register Assignments – BiLF16 (16 bit) 32

Appendix C Modbus Configuration Parameters 43

 Copyright 2011 Bitronics LLC

50 SERIES MANUAL SET

ML0035	M650 Family User Manual
ML0036	50 Series DNP3 Protocol
ML0037	50 Series Modbus Protocol
ML0038	M350 Family User Manual
ML0039	M651 Family User Manual
ML0040	M653 Family User Manual

VERSION HISTORY (ABRIDGED)

V1.010	2010-03-25	M650M3x51x models with firmware download capability
V1.030	2010-05-14	Add 0-1mA, add per-phase power demands to protocols
V1.040	2010-06-17	Add M350 models, add configurable display screens
V1.050	2010-07-14	Add secondary volts screens, more info to front panel menu
V1.060	2010-07-20	Add support for B3 models
V1.070	2010-08-03	Add support for 1A input and 4-20mA output
V1.090	2010-10-27	Add support for M651 models
V2.010	2011-02-18	Add support for configurable points
V3.000	2011-09-08	Add support for M653 models, split-core CTs, passwords, analog events, Primary Units

Copyright 2011 Bitronics LLC

CERTIFICATION

Bitronics LLC certifies that the calibration of our products is based on measurements using equipment whose calibration is traceable to the United States National Institute of Standards Technology (NIST).

INSTALLATION AND MAINTENANCE

Bitronics LLC products are designed for ease of installation and maintenance. As with any product of this nature, installation and maintenance can present electrical hazards and should be performed only by properly trained and qualified personnel. If the equipment is used in a manner not specified by Bitronics LLC, the protection provided by the equipment may be impaired.

WARRANTY AND ASSISTANCE

This product is warranted against defects in materials and workmanship for a period of thirty-six (36) months from the date of their original shipment from the factory. Products repaired at the factory are likewise warranted for eighteen (18) months from the date the repaired product is shipped, or for the remainder of the product's original warranty, whichever is greater. Obligation under this warranty is limited to repairing or replacing, at our designated facility, any part or parts that our examination shows to be defective. Warranties only apply to products subject to normal use and service. There are no warranties, obligations, liabilities for consequential damages, or other liabilities on the part of Bitronics LLC except this warranty covering the repair of defective materials. The warranties of merchantability and fitness for a particular purpose are expressly excluded.

For assistance, contact Bitronics LLC at:

Telephone: 610.997.5100
Fax: 610.997.5450
Email: bitronics@novatechweb.com
Website: www.novatechweb.com/bitronics

Shipping:

261 Brodhead Road
Bethlehem, PA 18017-8698
USA

 Copyright 2011 Bitronics LLC

COPYRIGHT NOTICE

This manual is copyrighted and all rights are reserved. The distribution and sale of this manual is intended for the use of the original purchaser or his agents. This document may not, in whole or part, be copied, photocopied, reproduced, translated or reduced to any electronic medium or machine-readable form without prior consent of Bitronics LLC, except for use by the original purchaser.

The product described by this manual contains hardware and software that is protected by copyrights owned by one or more of the following entities:

Bitronics LLC, 261 Brodhead Road, Bethlehem, PA 18017;
Schneider Automation, Inc., One High Street, North Andover, MA 01845;
Triangle MicroWorks, Inc., 2213 Middlefield Court, Raleigh, NC 27615
Freescale Semiconductor, Inc., 6501 William Cannon Drive West, Austin, TX 78735, USA

gzip inflation uses code Copyright 2002-2008 Mark Adler

inarp uses WinPcap, which is Copyright 1999-2005 NetGroup, Politecnico di Torino (Italy), and 2005-2010 CACE Technologies, Davis (California).

TRADEMARKS

The following are trademarks or registered trademarks of Bitronics, LLC:
The Bitronics logo Bitronics PowerPlex Triplex Triple-II
MultiComm PowerServe SubCycle Technology SubCycleStuf

The following are trademarks or registered trademarks of the DNP User's Group:
DNP DNP3

The following are trademarks or registered trademarks of Schneider Automation, Inc.:
MODSOFT Modicon Modbus Plus Modbus Compact 984 PLC

SAFETY SECTION

Please refer to the M650 User Manual (ML0035), the M350 User Manual (ML0038), or the M651 User Manual (ML0039) for information regarding safety, installation, commissioning and decommissioning.

1.0 MODBUS INTERFACE

1.1 Description

The 50 Series meters support the Modbus protocol on the serial ports. This port can be configured for RS-232 or RS-485. Refer to the M650 and M350 User Manuals for hardware details.

The Modbus network is a "MASTER" to "SLAVE" network, that is to say, one node asks a question and a second node answers. A NODE is a Modbus device (PLC, Computer, M650, etc.) that is connected to the network. Each SLAVE NODE has an ADDRESS in the range of 1 to 247; it is this address that allows a MASTER to selectively request data from any other device. Address 0 is a BROADCAST ADDRESS that can be used with certain MODBUS functions to allow the MASTER to address all SLAVE NODES at one time. The 50 Series meters do not respond to BROADCAST messages.

The Modbus implementation in the 50 Series conforms to all standard Modbus specifications and capabilities, such as maximum nodes, distance, signal sensitivity, etc. The 50 Series meters are classified as SLAVE DEVICES in the Modbus structure. The data items that are available from the instrument can be obtained via the Modbus Network by issuing a READ HOLDING REGISTERS command from the requesting node.

1.2 Modbus Address

The serial port in the 50 Series meters can be set up to be RS-232 or RS-485, and support baud rates up to 115200. Configuring the Serial Ports can be accomplished by using the display buttons or via a standard web browser while setting the address is done via a web browser only.

1.3 Transaction Timing

The instrument completes a set of calculations approximately every 100ms. The HOST CPU processor services the Modbus port by interrupts received from the corresponding serial port. Incoming messages are parsed and response initiated in approximately 50 ms.

1.4 Data Format

The 50 Series meters contain a set of holding registers (4XXXX) into which the instrument places values that correspond to the measurements the instrument is making. These holding registers can be read by any other device on the network using a READ HOLDING REGISTER (Function Code 3).

When using HOLDING REGISTER DATA, the Health Check Register should always be read and checked before interpreting data, since some failure modes will cause erroneous data to be presented (See Section 1.7). Appendix A provides the Legacy or Bitronics Legacy Fixed (BiLF) register set for the 12-bit default. Appendix B provides the 16-bit BiLF version.

 Copyright 2011 Bitronics LLC

NOTE: Unless otherwise specified, all points are READ ONLY.

 Copyright 2011 Bitronics LLC

1.4.1 Modbus Calculation-Type Codes

The Modbus Type codes for Optimal Resolution that are applicable to the register assignments in the appendix tables are highlighted within the following Calculation Type table.

Type	Value / Bit Mask	Description
T1		Unsigned 16-Bit Integer $kWh\,(kVARh) = Value_{HIGH} \times 10{,}000 + Value_{LOW}$
T2		Signed 16-Bit Integer - 2's Complement - Saturation 10
		Float Value = ((Integer Value) / 32768) * Scale * 10) $AMPERES_{(Inst,Fund,Demand,\mathrm{Max})} = \frac{Value}{32768} \times 10^{*} \times CT_{RATIO}$
		Example: 5.0 A stored as 16384 when Amp Scale = 1:1
T3		Signed 16-Bit Integer - 2's Complement - Saturation 15
		Float Value = ((Integer Value) / 32768) * Scale * 15) $AMPERES_{N\,(Inst,Fund,Demand,\mathrm{Max})} = \frac{Value}{32768} \times 15^{*} \times CT_{RATIO}$
		Example: 150 A stored as 16384 when Amp Scale = 20:1
T4		Signed 16-Bit Integer - 2's Complement - Saturation 150
		Float Value = ((Integer Value) / 32768) * Scale * 150) $VOLTS_{L\text{-}N\,(Inst,Fund,Demand,\mathrm{Min},\mathrm{Max})} = \frac{Value}{32768} \times 150 \times PT_{RATIO}$
		Example: 119.998 V stored as 26214 when Volt Scale = 1:1
T5		Signed 16-Bit Integer - 2's Complement - Saturation 1500
		Float Value = ((Integer Value) / 32768) * Scale * 1500) $WATTs\,(VARs)(VAs)_{PER\ PHASE\,(Inst)} = \frac{Value}{32768} \times 1500^{*} \times PT_{RATIO} \times CT_{RATIO}$
		Example: -750.0 W stored as -16384 when Volt Scale = 1:1, Amp Scale 1:1
T6		Signed 16-Bit Integer - 2's Complement - Saturation 4500
		Float Value = ((Integer Value) / 32768) * Scale * 4500) $WATTs\,(VARs)(VAs)_{TOTAL\,(Inst,Demand,\mathrm{Min},\mathrm{Max})} = \frac{Value}{32768} \times 4500^{*} \times PT_{RATIO} \times CT_{RATIO}$
		Example: -90.0 kW stored as -8192 when Volt Scale = 20:1, Amp Scale 4:1
T7		Signed 16-Bit Integer - 2's Complement - 3 Decimal Places $POWER\ FACTOR_{(True,Displacement)} = \frac{Value}{1000}$

 Copyright 2011 Bitronics LLC

Type	Value / Bit Mask	Description
		Example: -12.345 stored as -12345
T8		Signed 16-Bit Integer - 2's Complement - 2 Decimal Places $FREQUENCY = \frac{Value}{100}$
		Example: 123.45 stored as 12345
T9		Signed 16-Bit Integer - 2's Complement -1 Decimal Place
		Example: -1234.5 stored as -12345
T10		Unsigned 16-Bit Integer - Normalized Ratio
		ratio = (Normalized Ratio / Ratio Divisor)
		Example : 1.234, 12.34, 123.4, and 1234 are all stored as 1234
T11		Unsigned 16-Bit Integer - Ratio Divisor
		ratio = (Normalized Ratio / Ratio Divisor); valid Ratio Divisors are 1,10,100,1000
		Example: X.XXX stored as 1000, XX.XX stored as 100, XXX.X stored as 10
T12		Signed 16-Bit - 2's Complement - Saturation 2
		Gain Value = Integer Value /16384)
		Example: -0.250 stored as -4096
T13		Unsigned 16-Bit Integer - 12 Bit Offset Binary - Saturation 10
		Float Value =((Integer Value - 2047) / (2048)) * Scale * 10 $AMPERES_{(Inst, Fund, Demand, \text{Max})} = \frac{Value - 2047}{2048} x\ 10^{*} x\ CT_{RATIO}$
		Example: 5.0 A stored as 3071 when Amp Scale 1:1
T14		Unsigned 16-Bit Integer - 12 Bit Offset Binary - Saturation 150
		Float Value =((Integer Value - 2047) / (2048)) * Scale * 150 $VOLTs_{L-N\ (Inst, Fund, Demand, \text{Min}, \text{Max})} = \frac{Value - 2047}{2048} x\ 150\ x\ PT_{RATIO}$
		Example: 119.97 V stored as 3685 when Volt Scale 1:1
T15		Unsigned 16-Bit Integer - 12 Bit Offset Binary - Saturation 1000
		Float Value =((Integer Value - 2047) / (2048)) * Scale * 1000 $WATTs\,(VARs)(VAs)_{PER\ PHASE\ (Inst)} = \frac{Value - 2047}{2048} x\ 1000^{*} x\ PT_{RATIO}\ x\ CT_{RATIO}$
		Example: -500 W stored as 1023 when Volt Scale = 1:1, Amp Scale = 1:1
T16		Unsigned 16-Bit Integer - 12 Bit Offset Binary - Saturation 3000
		Float Value =((Integer Value - 2047) / (2048)) * Scale * 3000 $WATTs\,(VARs)(VAs)_{TOTAL\ (Inst, Demand, \text{Min}, \text{Max})} = \frac{Value - 2047}{2048} x\ 3000^{*} x\ PT_{RATIO}\ x\ CT_{RATIO}$

 Copyright 2011 Bitronics LLC

Type	Value / Bit Mask	Description
		Example: 349.10 kW stored as 3040 when Volt Scale = 6:1, Amp Scale = 40:1
T17		Unsigned 16-Bit Integer - 12 Bit Offset Binary - Saturation 15
		Float Value =((Integer Value - 2047) / (2048)) * Scale * 15 $AMPERES_{N\,(Inst,Fund,Demand,Max)} = \frac{Value - 2047}{2048} x\, 15^{*} x\, CT_{RATIO}$
		Example: 11.79 A stored as 2369 when Amp Scale 5:1
T18		Unsigned 16-Bit Integer - 12 Bit Offset Binary -1 Decimal Place
		Float Value = ((Integer Value - 2047) / (10))
		Example: 121.4 degrees stored as 3261
T19		Unsigned 16-Bit Integer - 12 Bit Offset Binary -3 Decimal Place
		Float Value = ((Integer Value - 2047) / (1000)) $PF_{(True,Displacement)} = \frac{Value - 2047}{1000}$
		Example: 0.978 Power Factor stored as 3025
T20		Unsigned 16-Bit Integer - Bit Control/Status
		0' - stored as zero; '1' - stored as 65536
T21		Unsigned 16-Bit Integer - 3 Decimal Places
		Example: 54.321 stored as 54321
T22		Bit
		Example: 1-bit is set, 0-bit is clear
T23		Signed 16-Bit Integer – 2's complement – Saturation 300
		Float Value = ((Integer Value)/32768) * Scale * 300)
		Example: 207.846 V stored as 22702 when Volt Scale = 1:1
T24		Signed 16-Bit Integer – 2's Complement – 3 Decimal Places, offset by 60
		Float Value = (Integer Value)/1000) + 60.0)
		Example: 60.005Hz stored as 5

 Copyright 2011 Bitronics LLC

The above equations provide answers in basic units (VOLTs, AMPs, WATTs, VARs, VAs and Hz). If the user desires other units such as KILOVOLTS, KILOWATTS or KILOVARS, the answers given by the equations should be divided by 1,000. If the user desires MEGAWATTS or MEGAVARS, the answers given by the equations should be divided by 1,000,000. Energy values are in units of kWh or kVARh.

The **Value** referred to in the equations would be the value stored in the register that you wished to convert to engineering units. For example if you wanted to convert Phase A Amperes into engineering units, Value would be the value in 40003.

ENERGY is stored as 32-BIT values in static COUNTER registers. Energy values are in units of PRIMARY kWh or kVARh.

1.5 Configuration

1.5.1 Setting CT and VT Ratios

The 50 Series meters are capable of internally storing and recalling CT and VT ratios. The CT and VT ratios are set using the web configuration interface, and are stored in non-volatile memory on the CT/VT section of the power supply board. Ratios can be read from registers 40041 through 40044. Each ratio is stored in two registers, one for the Normalized Ratio and the other for the Ratio Divisor. Allowable constants for the normalized ratios are 1000 to 9999. The Ratio Divisors may be 1, 10, 100, or 1000 only. The number stored will be the high side rating of the CT Ratio or VT Ratio. Both a 500:5 ratio CT and a 100:1 CT will have a value of 100 stored. For example, to calculate a CT and VT ratio for Phase A from the data stored in the M650, use the following equation:

$$Phase\ A\ CT_{RATIO} = \frac{Phase\ A\ CT\ Value\ (40041)}{Phase\ A\ CT\ Ratio\ Divisor\ (40042)}$$

$$Phase\ A\ PT_{RATIO} = \frac{Phase\ A\ PT\ Value\ (40043)}{Phase\ A\ PT\ Ratio\ Divisor\ (40044)}$$

The M650/M651 meters calculate all measured quantities in **SECONDARY UNITS (except energy)**, like other Bitronics instruments (such as MultiComm and PowerPlex). The CT and VT ratio information is used to calculate the primary values.

In the event of a CT/VT Ratio Checksum Failure, the value in the Normalized CT Ratio and Normalized VT Ratio registers default to 1000, and the value in the CT Ratio Divisor and VT Ratio Divisor default to 1000. This results in a 1:1 CT Ratio and 1:1 VT Ratio.

> WARNING – TO PRESERVE SYSTEM PERFORMANCE, ONLY WRITE TO RATIO REGISTERS WHEN THE RATIOS NEED TO BE CHANGED.

 Copyright 2011 Bitronics LLC

1.5.2 Resetting Energy and Demands

The Energy and Demand registers can be RESET by writing a non-zero value to the appropriate Holding Registers.

Reset Functions
Reset Energy
Reset Demand Amps
Reset Demand Volts
Reset Demand Power

1.5.3 Tag Register

The 50 Series meters provide a "TAG" register for user identification purposes. This register is a READ/WRITE register that allows the user to write a number from 0 to 65,535 in the tag register. The tag register is stored in non-volatile memory and can also be read/written through the web interface.

1.6 Register Sets and Register Types

The 50 Series meters are shipped with a pre-defined set of registers and data types. These fixed registers do not change. The List of Available Measurements may be found in the User Manuals. It is possible to create a custom register list from the available measurements. The Ethernet port and web browser are required to create the custom register list. See section 1.10 for more detail.

For users who wish to use the 50 Series on systems configured for other Bitronics products, a legacy register list may be selected. This legacy register list cannot be modified and will cause the M650/M651 to emulate the response of a Bitronics MultiComm or PowerPlex product. Note that the M350 has a fixed list that follows the same mapping as that of the M650/M651 only with gaps where the unavailable measurements would be. The Bitronics Legacy register list BiLF12 can be found in appendix A. There is also a BiLF 16 register set shown in Appendix B that provides better resolution.

To use the M650/M651 with a Bitronics Analog Output Converter (AOC), model NAO8101 or NAO8102, it will be necessary to select the legacy registers BiLF12 (12-bit).

1.7 Primary Units

An option exists to choose Primary Units instead of the pre-existing scaling mode, 'Optimal Resolution' adding the concept of 'scaling modes' to Mx50. The pre-existing scaling mode is called 'Optimal Resolution' on the basis that resolution of the protocols are optimized based on secondary full scale and therefore independent of CT and VT settings. The 'Primary Units' mode creates protocol values that include CT and VT settings, which

 Copyright 2011 Bitronics LLC

requires the user to choose a scaling factor (in multiples of 10). The scaling factor must be selected such that it achieves the desired resolution and does not cause an overflow in the protocol value. The Scaling mode selection and the scaling factors are maintained separately for both Modbus and DNP and are configured on the Settings/Protocol webpage. Below is a screen shot and explanation of the Primary Units mode:

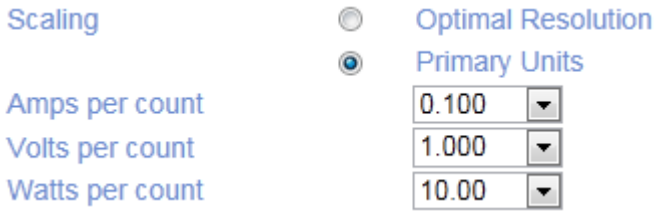

There are three new configurable parameters:

- Amps per count – APC
- Volts per count – VPC
- Watts per count - WPC

There are three new calculation types:

- Currents - B16_2S_PRIMARY_I
  $Measurement = ProtocolValue * APC$
- Voltages - B16_2S_PRIMARY_V
  $Measurement = ProtocolValue * VPC$
- Powers - B16_2S_PRIMARY_P
  $Measurement = ProtocolValue * WPC$

When Primary Unit mode is selected, appropriate calculation types are substituted per the following table. This substitution occurs across all pre-defined and user configured register sets. Note, other calculation types are unaffected as they represent their values (such as Frequency, Power factor) in primary units even in Optimal Resolution mode. Also, since the 12-bit calculation types are not included in the substitution this means that the Modbus BiLF12 register set is not affected.

Modbus Manual	DNP Manual	Optimal Resolution Calculation Type	Replaced by Calculation Type	Note
T2	T2	B16_2S_10_M10	B16_2S_PRIMARY_I	
T3	T3	B16_2S_15_M15	B16_2S_PRIMARY_I	
T4	T4	B16_2S_150_M150	B16_2S_PRIMARY_V	
T23	T23	B16_2S_300_M300	B16_2S_PRIMARY_V	
na	na	B16_2S_600_M600	B16_2S_MULT_10	Power supply voltage
T5	T5	B16_2S_1500_M1500	B16_2S_PRIMARY_P	
T6	T6	B16_2S_4500_M4500	B16_2S_PRIMARY_P	

Copyright 2011 Bitronics LLC

1.8 Health Check

The 50 Series has several self-tests built in to ensure that the instrument is performing accurately. The results of these self-tests are available in the Health Check register (40001), which is a simple 16-bit binary value. Each bit represents the results of a particular self-test, with "0" indicating the test was passed, and "1" indicating the test was failed.

If Health status failures occur, the meter may have experienced an operational failure. The table below provides a reference of error codes. Contact the factory for further instructions.

Health Check Error Codes	
Bit	Description
0	Checksum error on analog output (either 0-1mA or 4-20mA) calibration constants
2	Checksum error on gain calibration of inputs
4	Checksum error on phase calibration of inputs
12	Indicates firmware download in progress and measurements are offline

1.9 Heartbeat State Counter

50 Series meters provide a Heartbeat State Counter Register that allows the user to determine the time between successive polls. This counter will increment by the number of milliseconds that have elapsed since the last time the data was updated. Another use of this register is as a visual indicator that the data is changing; it allows users of certain MMIs to identify disruption in the polling of the instrument. The Heartbeat State Counter is a full 16-bit counter that rolls over at 65535 (65.535 seconds). The counter starts at zero on power-up, and is NOT stored in non-volatile memory.

1.10 Meter ID Register

50 Series meters provide a "Meter Type ID" register for model identification purposes (40055 for 50 Series default register set) which returns a value of 600 (BiLF12 Modbus, BiLF DNP), 601 (BiLF16 Modbus), or 602 (TUC DNP/ Modbus).

1.11 Custom Register Lists

From the Protocol Configuration page, there are four Modbus register set choices in the “Register Set” dropdown box: BiLF16, BiLF12, TUC1 and TUC2.
The BiLF12 and BiLF16 (Bitronics Legacy Fixed) register set definitions can be viewed by clicking on the “View Registers” button, located next to the “Register Set” dropdown box. These standard register sets cannot

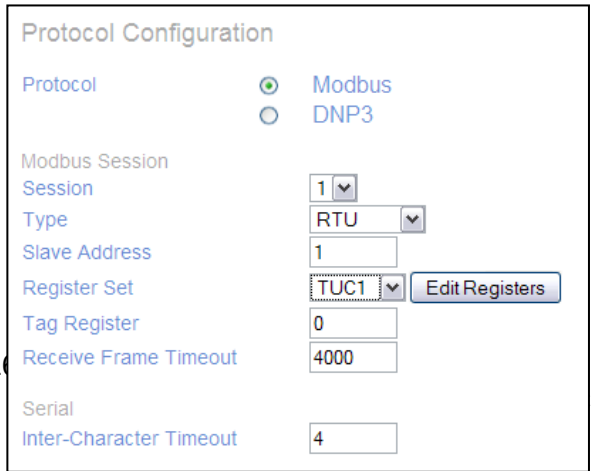

be edited.
The “TUC” or “Totally User Configurable” register sets are intended to allow you to define your own custom register sets. There are two, independent custom register sets, TUC1 and TUC2. The button next to the Register set dropdown list changes from “View Registers” to “Edit Registers” when one of these editable register sets is selected. Click on “Edit Registers” to begin configuring a register set.
The “View Registers”/“Edit Registers” button brings you to the Modbus Register Configuration page. A register summary list is shown, which includes the register number, measurement name and calculation type of the selected register set.

Modbus Register Configuration
Register Measurement Calc Type
40001 Health B16_LOC_HEALTH_LO
40002 RMS Amps A B16_2S_10_M10
40003 RMS Amps B B16_2S_10_M10
40004 RMS Amps C B16_2S_10_M10
40005 RMS Volts A B16_2S_150_M150
40006 RMS Volts B B16_2S_150_M150
40007 RMS Volts C B16_2S_150_M150
40008 RMS Watts Total B16_2S_4500_M4500
40009 RMS VARs Total B16_2S_4500_M4500
40010 RMS Watts A B16_2S_1500_M1500
40011 RMS Watts B B16_2S_1500_M1500
40012 RMS Watts C B16_2S_1500_M1500
40013 RMS VARs A B16_2S_1500_M1500
40014 RMS VARs B B16_2S_1500_M1500
40015 RMS VARs C B16_2S_1500_M1500
40016 CT Scale Factor Normalized Ratio B16W_RATIO_NORMAL
Edit List
Cancel
Apply

Click the “Edit List” button to modify the register list. This button is disabled for the standard (non-editable) register sets.

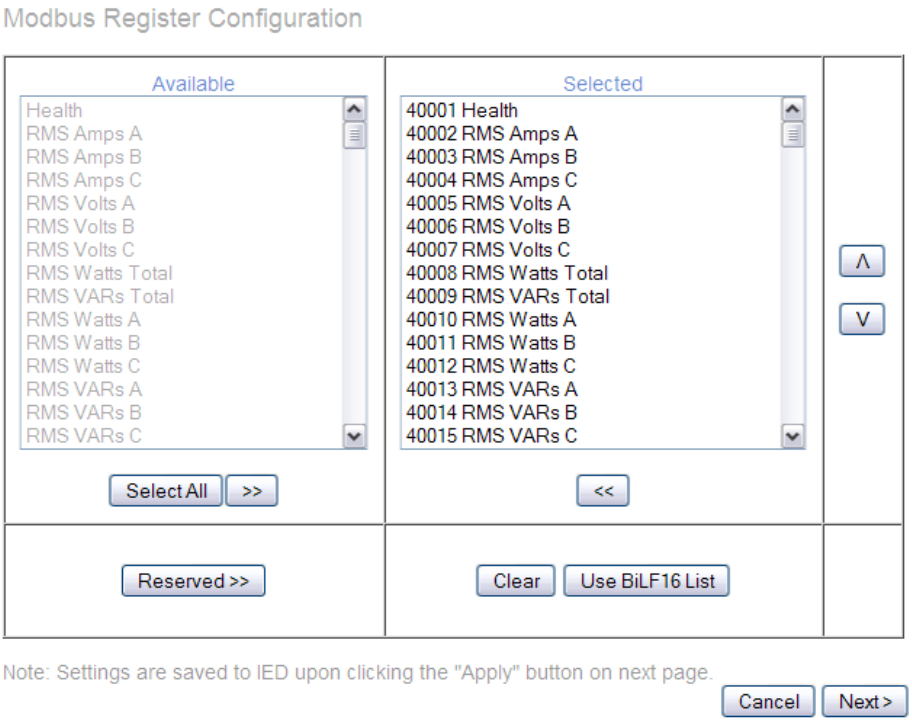

All available measurements and data are displayed in the “Available” list in the left-

Copyright 2011 Bitronics LLC

hand pane. The present register configuration is shown in the “Selected” list in the right-hand pane. Measurement and data items can be added to and removed from the “Selected” list using the buttons on the page:

- Select All – Highlights all measurement/data items in “Available” list
- >> – Places highlighted measurement/data items from “Available” list into the “Selected” list.
- Reserved >> – Places a “Reserved” placeholder item in the “Selected” list.
- << – Removes highlighted items from the “Selected” list.
- Λ – Shifts highlighted items in the “Selected” list up by one point position.
- V – Shifts highlighted items in the “Selected” list down by one point position.
- Clear – Clears the “Selected” list for selected DNP Type.
- Use BiLF16 List – Replaces the entire “Selected” list with the standard BiLF points list. A “Class 0 Enable” can be entered to programmatically configure Class 0 for all items in the list.

NOTES

- Multiple items can be selected at once using the shift or control keys.
- Any item that appears in the “Selected” list appears gray in the “Available” list.
- The same data item can be used in multiple different registers.
- Items added to the “Selected” list will be placed *above* the first highlighted item.
- If no items are highlighted in the “Selected” list, items are added to the end of the list.

 Copyright 2011 Bitronics LLC

2.0 MODBUS PROTOCOL

2.1 Introduction

The MODBUS protocol is an open standard which defines a command-response method of communicating digital information between a master and slave device. The electrical connection between devices is known as a bus. In MODBUS, two types of devices attach to the bus, master and slave devices. A master device issues commands to slaves. A slave device, such as a 50 Series meter, issues responses to master commands that are addressed to them. Each bus must contain exactly one master and may contain as many slaves as the electrical standards permit.

All devices on a bus must operate according to the same electrical standards (i.e. all must be RS-232C or all must be RS-485). RS-232C standards specify that only two devices may be connected to a bus (i.e. only one slave is allowed). RS-485 specifications allow up to 32 devices (31 slaves) on a bus.

The MODBUS protocol specifications define two types of transmission modes: ASCII and RTU. This manual describes only the more common RTU mode. For more information, the manual "MODICON MODBUS PROTOCOL REFERENCE GUIDE" (PI-MBUS-300) may be purchased for a nominal fee directly from Modicon Inc.

2.2 MODBUS RTU Message Framing

Each message from either a master or slave consists of a continuous stream of characters. A silent interval of 3.5 character times (3.5 * 11 bits / 9600 baud = 3.5 millisecond), or more, separates these streams. Bitronics 50 Series instruments implement this requirement by waiting for a 4 millisecond (configurable) gap between characters. If the stream is valid and is addressed to this instrument, then the instrument responds as follows:

Enable the output interface drivers (RS-485 option only)
Wait TX Delay time (if configured)
Send the response as a continuous stream
Disable the output interface drivers (RS-485 option only)

2.3 MODBUS RTU Message Content

The MODBUS RTU message stream consists of an address byte, a function code byte, a number of message bytes, and two check bytes. The address byte, which is in the range 1... 247, specifies the identity of the slave device. The function code byte in a master command indicates the operation that the slave is to perform. The function code byte in a slave response is the same value as the master command function code if no error occurs, otherwise it has 128 added to it. The message bytes in a command contain additional information needed to perform the command. Message bytes in a response contain the data requested if no error has occurred or a one-byte exception code upon errors. The check bytes are generated using the CRC-16 polynomial generator sequence (x16 + x15 + x2 + 1) with the remainder pre-initialized to all 1's. The most significant byte of the CRC is transmitted first.

2.4 MODBUS Function Codes

 Copyright 2011 Bitronics LLC

Bitronics instruments currently support the function codes shown in the following table. Note that the values are shown in hexadecimal (base 16). This table also shows the value that a slave would return upon an error.

MODBUS Function Codes			
Master Function	Slave Error	Name	Meaning
03_{16}	83_{16}	Read Holding Registers	Read values from transducer
06_{16}	86_{16}	Preset Single Register	Write ratio or reset energy/demand
10_{16}	90_{16}	Preset Multiple Registers	Write ratio or reset energy/demand

2.5 MODBUS Exception Codes

Bitronics instruments return exception codes back to the master upon certain conditions. All functions codes greater then 127 decimal ($7F_{16}$ or 0x7F) indicate a slave error response. The message byte indicates the exception code according to the following table:

MODBUS Exception Codes		
Code	Name	Meaning
1	Illegal Function	Master command contained an unrecognized function code.
2	Illegal Data Address	Starting address is illegal. Note that some registers are read-only and some are read/write.
3	Illegal Data Value	Either the register count is invalid or an attempt to write an illegal register value was found. Note that this code can be caused by attempting to read beyond the last instrument register.
4	Slave Device Failure	Instrument has failed. If problem persists, please consult customer service.

2.6 Supported MODBUS Commands

Bitronics instruments support one read and two write commands. All commands require a register address to be specified in the command. The first register, named 40001 is at hexadecimal address 0x0000. The energy/demand reset register, named 40100 is at hex address 0x0063. In commands and responses, the most significant byte of a two-byte value is transmitted first. All examples that follow use the hexadecimal values and an instrument address of 1.

 Copyright 2011 Bitronics LLC

2.6.1 Read Holding Registers (Function Code 03)

This function reads from 1 to 125 registers from the Bitronics instrument. The command requires a starting register and the number of registers to read. Attempting to read non-existent registers will cause an exception. Modbus read commands are limited to 125 registers maximum per read request, and some Modicon PLC Master Blocks (MSTR) are limited to 100 registers maximum per read request. The following example (M650 register set) shows two registers being read: Watts Total (register 40008) and VARs Total (40009).

COMMAND - Function Code 03 (Read Holding Registers)			
Byte	**Name**	**Example**	**Notes**
1	Slave Address	1	
2	Function code	3	
3	Start address high	0	Watts Total at register 40008
4	Start address low	7	(40008-40001=07)
5	Register count high	0	
6	Register count low	2	Read 2 registers total
7	CRC-16 low	75	
8	CRC-16 high	CA	

RESPONSE - Function Code 03 (Read Holding Registers)			
Byte	**Name**	**Example**	**Notes**
1	Slave Address	1	
2	Function code	3	
3	Byte count	4	2 registers, 2 bytes each
4	Data high (40008)	66	Watts Total = 6670 hex = 26224 decimal
5	Data low (40008)	70	
6	Data high (40009)	66	VARs Total = 6650 hex = 26192 decimal
7	Data low (40009)	50	
8	CRC-16 low	CE	
9	CRC-16 high	FC	

Copyright 2011 Bitronics LLC

2.6.2 Preset Single Register (Function Code 06)

This function writes to a single register. An attempt to write to a READ-ONLY register results in an exception response. The response to a valid (writeable) register command is an echo of the command. The following example shows reset Energy command by writing 1 to register 40100.

COMMAND and RESPONSE - Function Code 06 (Preset Single Register)			
Byte	**Name**	**Example**	**Notes**
1	Slave Address	1	
2	Function code	6	
3	Start address high	0	0063 hex = 99 to specify register 40100
4	Start address low	63	
5	Data high	00	
6	Data low	01	1
7	CRC-16 low	B8	
8	CRC-16 high	14	

2.6.3 Preset Multiple Registers (Function Code 16)

This function writes one or more contiguous registers. An attempt to write to a READ-ONLY register results in an exception. The following example shows writing the Reset registers (40100 - 40103).

COMMAND - Function Code 16 (Preset Multiple Registers)			
Byte	**Name**	**Example**	**Notes**
1	Slave Address	01	
2	Function code	10	10 hex = 16 decimal
3	Start address high	00	63 hex = 99 decimal = 40100 (reset energy)
4	Start address low	63	
5	Register count high	00	We write 4 registers (40100 - 40103)
6	Register count low	04	
7	Byte count	08	Four register = 8 bytes
8	Data high	00	Write 1 to register 40100 (Reset energy)
9	Data low	01	
10	Data high	00	Write 1 to register 40101 (Reset demand amps)
11	Data low	01	
12	Data high	00	Write 1 to register 40102 (Reset demand volts)
13	Data low	01	
14	Data high	00	Write 1 to register 40103 (Reset demand power)
15	Data low	01	
16	CRC-16 low	8F	
17	CRC-16 high	FE	

 Copyright 2011 Bitronics LLC

3.0 MODBUS OVER ETHERNET (TCP)

If the 50 Series meter is equipped with the Ethernet port enabled for protocols, then it will respond to Modbus commands via TCP. The 50 Series can communicate with any device certified by Schneider Automation, Inc. for Modbus over Ethernet, as well as other devices. The 50 Series meters can support either Modbus or DNP3 and HTML protocols over the Ethernet link, but must be set the same as the serial port if the device is equipped with one. The table below lists default port assignments for all Ethernet based protocols supported by the 50 Series.

Protocol	Port number
DNP3	20000 (TCP, UDP)
Modbus	502 (TCP)
HTML	80 (TCP)

The Modbus/TCP interface allows up to 8 simultaneous connections to 50 Series meters. The configuration parameters are described in Appendix C. Any Unit_Id (including zero) will be accepted since there is only one device per IP address.

3.0.1 IP Addressing

The TCP/IP stack needs to be configured with an IP address, a SUBNET mask, and a ROUTER (GATEWAY) address. It is very important that the network have no duplicate IP addresses. Configuration of the address may be accomplished by a web browser, or via the front panel menu buttons.

The units are pre-configured with an IP address / subnet mask/gateway address of:

192.168.0.171 / 255.255.255.0 / 192.168.0.1

 Copyright 2011 Bitronics LLC

APPENDIX A BITRONICS LEGACY MODBUS REGISTER ASSIGNMENTS – BILF12 (DEFAULT – 12 BIT)

Note that all registers are available in M650/M651 (some don't apply for model B3), registers for M350 A3 or V3 are indicated under the Meter column

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	**Modbus Address**		**Contents**	**Data**	**Scale**	**Ind**	**Values/Dependencies**	**Type**	**Min**	**Max**	**Step**	**Meter**
3	40001		Health 0	T1		Bit-0	Non zero = Error	Data	0-Norm	1-Fail	1	
						Bit-1	Non zero = Error					
						Bit-2	Non zero = Error					
						Bit-3	Non zero = Error					
						Bit-4	Non zero = Error					
						Bit-5	Non zero = Error					
						Bit-6	Non zero = Error					
						Bit-7	Non zero = Error					
						Bit-8	Non zero = Error					
						Bit-9	Non zero = Error					
						Bit-10	Non zero = Error					
						Bit-11	Non zero = Error					
						Bit-12	Non zero = Error					
						Bit-13	Non zero = Error					
						Bit-14	Non zero = Error					
						Bit-15	Non zero = Error					
3	40002		Amps A	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40003		Amps B	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address	Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40004	Amps C	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40005	Volts A	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40006	Volts B	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40007	Volts C	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40008	Watts Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) W	
3	40009	VARs Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) vars	
3	40010	Watts A	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) W	
3	40011	Watts B	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) W	
3	40012	Watts C	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) W	
3	40013	VARs A	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) vars	
3	40014	VARs B	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) vars	
3	40015	VARs C	T15	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) vars	
3	40016	Amp Scale Factor	T10				Data	1000	9999	1	
3	40017	Volt Scale Factor	T10				Data	1000	9999	1	
3	40018	Amps Residual	T17	Amp Scale			Data	2047	4095	((1/2048) * 15 * Amp Scale) A	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40019		Watt-Hrs Normal (High Word)	T1				Data	0	65536	65536 Kilowatt-Hours	
3	40020		Watt-Hrs Normal (Low Word)	T1				Data	0	65536	1 Kilowatt-Hour	
3	40021		Watt-Hrs Reverse (High Word)	T1				Data	0	65536	65536 Kilowatt-Hours	
3	40022		Watt-Hrs Reverse (Low Word)	T1				Data	0	65536	1 Kilowatt-Hour	
3	40023		VAR-Hrs Lag (High Word)	T1				Data	0	65536	65536 KilovarHours	
3	40024		VAR-Hrs Lag (Low Word)	T1				Data	0	65536	1 KilovarHour	
3	40025		VAR-Hrs Lead (High Word)	T1				Data	0	65536	65536 KilovarHours	
3	40026		VAR-Hrs Lead (Low Word)	T1				Data	0	65536	1 KilovarHour	
3	40027		System Frequency	T8				Data	2000	8000	0.01 Hz	
3	40028		Unused	T1		0	spare unused register	Data	0	0	0	
3	40029		Unused	T1		0	spare unused register	Data	0	0	0	
3	40030		Unused	T1		0	spare unused register	Data	0	0	0	
3	40031		Heart Beat	T1				Data	0	65536	1 msec	
3	40032		Unused	T1		0	spare unused register	Data	0	0	0	
3	40033		VAs A	T15	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) VAs	
3	40034		VAs B	T15	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) VAs	
3	40035		VAs C	T15	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 1000 * Amp Scale * Volt Scale) VAs	
3	40036		VAs Total Geometric	T16	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) VAs	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address	Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40037	Power Factor A	T19				Data	1047	3047	0.001	
3	40038	Power Factor B	T19				Data	1047	3047	0.001	
3	40039	Power Factor C	T19				Data	1047	3047	0.001	
3	40040	Power Factor Total Geometric	T19				Data	1047	3047	0.001	
3	40041	Amp Scale Factor	T10				Setting	1000	9999	1	M350 A3
3	40042	Amp Scale Factor Divisor	T11				Setting	1	1000	Multiply by 10 (valid values are 1,10,100,1000)	M350 A3
3	40043	Volt Scale Factor	T10				Setting	1000	9999	1	M350 V3
3	40044	Volt Scale Factor Divisor	T11				Setting	1	1000	Multiply by 10 (valid values are 1,10,100,1000)	M350 V3
3	40045	Demand Amps A	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40046	Demand Amps B	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40047	Demand Amps C	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40048	Demand (Max) Amps A	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40049	Demand (Max) Amps B	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40050	Demand (Max) Amps C	T13	Amp Scale			Data	2047	4095	((1/2048) * 10 * Amp Scale) A	M350 A3
3	40051	Demand Amps Residual	T17	Amp Scale			Data	2047	4095	((1/2048) * 15 * Amp Scale) A	
3	40052	Demand (Max) Amps Residual	T17	Amp Scale			Data	2047	4095	((1/2048) * 15 * Amp Scale) A	
3	40053	Demand Volts A	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40054	Demand Volts B	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40055	Demand Volts C	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40056	Demand (Max) Volts A	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address	Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40057	Demand (Max) Volts B	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40058	Demand (Max) Volts C	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40059	Demand (Min) Volts A	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40060	Demand (Min) Volts B	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40061	Demand (Min) Volts C	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40062	Demand Watts Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) W	
3	40063	Demand (Max) Watts Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) W	
3	40064	Demand (Min) Watts Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) W	
3	40065	Demand VARs Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) vars	
3	40066	Demand (Max) VARs Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) vars	
3	40067	Demand (Min) VARs Total	T16	Amp Scale * Volt Scale			Data	0	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) vars	
3	40068	Demand VAs Total	T16	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) VAs	
3	40069	Demand (Max) VAs Total	T16	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) VAs	
3	40070	Demand (Min) VAs Total	T16	Amp Scale * Volt Scale			Data	2047	4095	((1/2048) * 3000 * Amp Scale * Volt Scale) VAs	
3	40071	Meter Type	T1		600	Legacy Register Set	Data	600	602	0	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40072		Protocol Version	T21				Data	0	65536	0.001	
3	40073		Factory Version Software	T21				Data	0	65536	0.001	
3	40074		DSP Version	T21				Data	0	65536	0.001	
3	40075		Volts N-G	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40076		Volts A-B	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40077		Volts B-C	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40078		Volts C-A	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40079		Unused	T1		0	spare unused register	Data	0	0	0	
3	40080		Unused	T1		0	spare unused register	Data	0	0	0	
3	40081		Unused	T1		0	spare unused register	Data	0	0	0	
3	40082		Unused	T1		0	spare unused register	Data	0	0	0	
3	40083		Unused	T1		0	spare unused register	Data	0	0	0	
3	40084		Unused	T1		0	spare unused register	Data	0	0	0	
3	40085		Unused	T1		0	spare unused register	Data	0	0	0	
3	40086		Unused	T1		0	spare unused register	Data	0	0	0	
3	40087		Unused	T1		0	spare unused register	Data	0	0	0	
3	40088		Unused	T1		0	spare unused register	Data	0	0	0	
3	40089		Unused	T1		0	spare unused register	Data	0	0	0	
3	40090		Unused	T1		0	spare unused register	Data	0	0	0	
3	40091		Unused	T1		0	spare unused register	Data	0	0	0	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	**Modbus Address**	**Contents**	**Data**	**Scale**	**Ind**	**Values/Dependencies**	**Type**	**Min**	**Max**	**Step**	**Meter**
3	40092	Unused	T1		0	spare unused register	Data	0	0	0	
3	40093	Unused	T1		0	spare unused register	Data	0	0	0	
3	40094	Unused	T1		0	spare unused register	Data	0	0	0	
3	40095	Unused	T1		0	spare unused register	Data	0	0	0	
3	40096	Unused	T1		0	spare unused register	Data	0	0	0	
3	40097	Unused	T1		0	spare unused register	Data	0	0	0	
3	40098	Unused	T1		0	spare unused register	Data	0	0	0	
3,6,16	40099	Tag Register	T1				Setting	0	65536	1	
3,6,16	40100	Reset Energy	T20		0	Normal	Setting	0	65536	65536	
					65536	Reset					
3,6,16	40101	Reset Demand Amps	T20		0	Normal	Setting	0	65536	65536	M350 A3
					65536	Reset					
3,6,16	40102	Reset Demand Volts	T20		0	Normal	Setting	0	65536	65536	M350 V3
					65536	Reset					
3,6,16	40103	Reset Demand Power	T20		0	Normal	Setting	0	65536	65536	
					65536	Reset					
3	40104	Unused	T1		0	spare unused register	Data	0	0	0	
3	40105	Unused	T1		0	spare unused register	Data	0	0	0	
3	40106	Demand Volts AB	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40107	Demand Volts BC	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF12 (Default – 12 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40108		Demand Volts CA	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40109		Demand (Max) Volts AB	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40110		Demand (Max) Volts BC	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40111		Demand (Max) Volts CA	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40112		Demand (Min) Volts AB	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40113		Demand (Min) Volts BC	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3
3	40114		Demand (Min) Volts CA	T14	Volt Scale			Data	2047	4095	((1/2048) * 150 * Volt Scale) V	M350 V3

- When connected to 2 Element (DELTA or 3-wire) systems, the Per-Element quantities may have no direct physical meaning. All registers are available in M650/M651 (although some don't apply for B3 models), registers available in M350 A3 or V3 are indicated under Meter.

Copyright 2011 Bitronics LLC

APPENDIX B BITRONICS LEGACY MODBUS REGISTER ASSIGNMENTS – BILF16 (16 BIT)

Note that all registers are available in M650/M651 (although some don't apply for B3), registers for M350 A3 or V3 are indicated under the Meter column

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)											
Code	**Modbus Address**	**Contents**	**Data**	**Scale**	**Ind**	**Values/Dependencies**	**Type**	**Min**	**Max**	**Step**	**Meter**
3	40001	Health 0	T1		Bit-0	Non zero = Error	Data	0-Norm	1-Fail	1	
					Bit-1	Non zero = Error					
					Bit-2	Non zero = Error					
					Bit-3	Non zero = Error					
					Bit-4	Non zero = Error					
					Bit-5	Non zero = Error					
					Bit-6	Non zero = Error					
					Bit-7	Non zero = Error					
					Bit-8	Non zero = Error					
					Bit-9	Non zero = Error					
					Bit-10	Non zero = Error					
					Bit-11	Non zero = Error					
					Bit-12	Non zero = Error					
					Bit-13	Non zero = Error					
					Bit-14	Non zero = Error					
					Bit-15	Non zero = Error					
3	40002	Amps A	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)												
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40003		Amps B	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40004		Amps C	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40005		Volts A	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40006		Volts B	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40007		Volts C	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40008		Watts Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) W	
3	40009		VARs Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) vars	
3	40010		Watts A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40011		Watts B	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40012		Watts C	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40013		VARs A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) vars	
3	40014		VARs B	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) vars	
3	40015		VARs C	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) vars	
3	40016		Amp Scale Factor					Data	1000	9999	1	
3	40017		Volt Scale Factor					Data	1000	9999	1	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40018		Amps Residual	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	
3	40019		Watt-Hrs Normal (High Word)	T1				Data	0	65536	65536 Kilowatt-Hours	
3	40020		Watt-Hrs Normal (Low Word)	T1				Data	0	65536	1 Kilowatt-Hour	
3	40021		Watt-Hrs Reverse (High Word)	T1				Data	0	65536	65536 Kilowatt-Hours	
3	40022		Watt-Hrs Reverse (Low Word)	T1				Data	0	65536	1 Kilowatt-Hour	
3	40023		VAR-Hrs Lag (High Word)	T1				Data	0	65536	65536 KilovarHours	
3	40024		VAR-Hrs Lag (Low Word)	T1				Data	0	65536	1 KilovarHour	
3	40025		VAR-Hrs Lead (High Word)	T1				Data	0	65536	65536 KilovarHours	
3	40026		VAR-Hrs Lead (Low Word)	T1				Data	0	65536	1 KilovarHour	
3	40027		Frequency Volts A	T8				Data	2000	8000	0.001 Hz	
3	40028		Unused	T1		0	spare unused register	Data	0	0	0	
3	40029		Unused	T1		0	spare unused register	Data	0	0	0	
3	40030		Unused	T1		0	spare unused register	Data	0	0	0	
3	40031		Heart Beat	T1				Data	0	65536	1 msec	
3	40032		Unused	T1		0	spare unused register	Data	0	0	0	
3	40033		VAs A	T5	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40034		VAs B	T5	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40035		VAs C	T5	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)											
Code	Modbus Address	Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40036	VAs Total Geometric	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) VAs	
3	40037	Power Factor A	T7				Data	-1000	1000	0.001	
3	40038	Power Factor B	T7				Data	-1000	1000	0.001	
3	40039	Power Factor C	T7				Data	-1000	1000	0.001	
3	40040	Power Factor Total Geometric	T7				Data	-1000	1000	0.001	
3,6,16	40041	Amp Scale Factor	T10				Setting	1000	9999	1	M350 A3
3,6,16	40042	Amp Scale Factor Divisor	T11				Setting	1	1000	Multiply by 10 (valid values are 1,10,100,1000)	M350 A3
3,6,16	40043	Volt Scale Factor	T10				Setting	1000	9999	1	M350 V3
3,6,16	40044	Volt Scale Factor Divisor	T11				Setting	1	1000	Multiply by 10 (valid values are 1,10,100,1000)	M350 V3
3	40045	Demand Amps A	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40046	Demand Amps B	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40047	Demand Amps C	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40048	Demand (Max) Amps A	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40049	Demand (Max) Amps B	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40050	Demand (Max) Amps C	T2	Amp Scale			Data	0	32767	((1/32768) * 10 * Amp Scale) A	M350 A3
3	40051	Demand Amps Residual	T3	Amp Scale			Data	0	32767	((1/32768) * 15 * Amp Scale) A	
3	40052	Demand (Max) Amps Residual	T3	Amp Scale			Data	0	32767	((1/32768) * 15 * Amp Scale) A	
3	40053	Demand Volts A	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40054	Demand Volts B	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)												
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40055		Demand Volts C	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40056		Demand (Max) Volts A	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40057		Demand (Max) Volts B	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40058		Demand (Max) Volts C	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40059		Demand (Min) Volts A	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40060		Demand (Min) Volts B	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40061		Demand (Min) Volts C	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40062		Demand Watts Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) W	
3	40063		Demand (Max) Watts Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) W	
3	40064		Demand (Min) Watts Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) vars	
3	40065		Demand VARs Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) vars	
3	40066		Demand (Max) VARs Total	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) vars	
3	40067		Demand (Min) VARs Total	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) VAs	
3	40068		Demand VAs Total	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) VAs	
3	40069		Demand (Max) VAs Total	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) VAs	
3	40070		Demand (Min) VAs Total	T6	Amp Scale * Volt			Data	-32768	32767	((1/32768) * 4500 * Amp Scale * Volt Scale) W	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
					Scale							
3	40071		Meter Type	T1		601	Legacy Register Set	Data	600	602	0	
3	40072		Protocol Version	T21				Data	0	65536	0.001	
3	40073		Factory Version Software	T21				Data	0	65536	0.001	
3	40074		DSP Version	T21				Data	0	65536	0.001	
3	40075		Volts N-G	T4	Volt Scale			Data	0	32767	((1/32768) * 150 * Volt Scale) V	M350 V3
3	40076		Volts A-B	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40077		Volts B-C	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40078		Volts C-A	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40079		System Frequency (1mHz)	T24				Data	-32768	32767	0.001Hz	
3	40080		Unused	T1		0	spare unused register	Data	0	0	0	
3	40081		Unused	T1		0	spare unused register	Data	0	0	0	
3	40082		Unused	T1		0	spare unused register	Data	0	0	0	
3	40083		Unused	T1		0	spare unused register	Data	0	0	0	
3	40084		Unused	T1		0	spare unused register	Data	0	0	0	
3	40085		Unused	T1		0	spare unused register	Data	0	0	0	
3	40086		Unused	T1		0	spare unused register	Data	0	0	0	
3	40087		Unused	T1		0	spare unused register	Data	0	0	0	
3	40088		Unused	T1		0	spare unused register	Data	0	0	0	
3	40089		Unused	T1		0	spare unused register	Data	0	0	0	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)												
Code	**Modbus Address**		**Contents**	**Data**	**Scale**	**Ind**	**Values/Dependencies**	**Type**	**Min**	**Max**	**Step**	**Meter**
3	40090		Unused	T1		0	spare unused register	Data	0	0	0	
3	40091		Unused	T1		0	spare unused register	Data	0	0	0	
3	40092		Unused	T1		0	spare unused register	Data	0	0	0	
3	40093		Unused	T1		0	spare unused register	Data	0	0	0	
3	40094		Unused	T1		0	spare unused register	Data	0	0	0	
3	40095		Unused	T1		0	spare unused register	Data	0	0	0	
3	40096		Unused	T1		0	spare unused register	Data	0	0	0	
3	40097		Unused	T1		0	spare unused register	Data	0	0	0	
3	40098		Unused	T1		0	spare unused register	Data	0	0	0	
3,6,16	40099		Tag Register	T1				Setting	0	65536	1	
3,6,16	40100		Reset Energy	T22		0	Normal	Setting	0	1	1	
						1	Reset					
3,6,16	40101		Reset Demand Amps	T22		0	Normal	Setting	0	1	1	M350 A3
						1	Reset					
3,6,16	40102		Reset Demand Volts	T22		0	Normal	Setting	0	1	1	M350 V3
						1	Reset					
3,6,16	40103		Reset Demand Power	T22		0	Normal	Setting	0	1	1	
						1	Reset					
3	40104		Unused	T1		0	spare unused register	Data	0	0	0	
3	40105		Unused	T1		0	spare unused register	Data	0	0	0	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)												
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40106		Demand Volts AB	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40107		Demand Volts BC	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40108		Demand Volts CA	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40109		Demand (Max) Volts AB	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40110		Demand (Max) Volts BC	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40111		Demand (Max) Volts CA	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40112		Demand (Min) Volts AB	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40113		Demand (Min) Volts BC	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40114		Demand (Min) Volts CA	T4	Volt Scale			Data	0	32767	((1/32768) * 300 * Volt Scale) V	M350 V3
3	40115		Volts Aux	T4				Data	0	32767	((1/32768) * 600) V	
3	40116		Watt-Hrs Net (High Signed)	T1				Data	0	65536	65536 Kilowatt-Hours	
3	40117		Watt-Hrs Net (Low Signed)	T1				Data	0	65536	1 Kilowatt-Hour	
3	40118		VA-Hrs (High)	T1				Data	0	65536	65536 KilovarHours	
3	40119		VA-Hrs (Low)	T1				Data	0	65536	1 KilovarHour	
3	40120		Max Average Watts A	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40121		Max Average Watts B	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40122		Max Average Watts C	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40123		Max Average VARs A	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40124		Max Average VARs B	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40125		Max Average VARs C	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)												
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40126		Max Average VAs A	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40127		Max Average VAs B	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40128		Max Average VAs C	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40129		Average Watts A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40130		Average Watts B	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40131		Average Watts C	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40132		Average VARs A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40133		Average VARs A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40134		Average VARs A	T5	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40135		Average VAs A	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40136		Average VAs B	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40137		Average VAs C	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40138		Min Average Watts A	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40139		Min Average Watts B	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40140		Min Average Watts C	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) W	
3	40141		Min Average VARs A	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40142		Min Average VARs B	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40143		Min Average VARs C	T6	Amp Scale * Volt Scale			Data	-32768	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VARs	
3	40144		Min Average VAs A	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40145		Min Average VAs B	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	

Copyright 2011 Bitronics LLC

Bitronics Legacy Modbus Register Assignments - BiLF16 (16 Bit)											
Code	Modbus Address		Contents	Data	Scale	Ind	Values/Dependencies	Type	Min	Max	Step	Meter
3	40146		Min Average VAs C	T6	Amp Scale * Volt Scale			Data	0	32767	((1/32768) * 1500 * Amp Scale * Volt Scale) VAs	
3	40147		Unused	T1		0	spare unused register	Data	0	0	0	
3	40148		Unused	T1		0	spare unused register	Data	0	0	0	
3	40149		Unused	T1		0	spare unused register	Data	0	0	0	
3	40150		Unused	T1		0	spare unused register	Data	0	0	0	
3	40151		Unused	T1		0	spare unused register	Data	0	0	0	
3	40152		Unused	T1		0	spare unused register	Data	0	0	0	
3	40153		Unused	T1		0	spare unused register	Data	0	0	0	
3	40154		Unused	T1		0	spare unused register	Data	0	0	0	
3	40155		Unused	T1		0	spare unused register	Data	0	0	0	
3	40156		Unused	T1		0	spare unused register	Data	0	0	0	
3	40157		Unused	T1		0	spare unused register	Data	0	0	0	
3	40158		Unused	T1		0	spare unused register	Data	0	0	0	
3	40159		Unused	T1		0	spare unused register	Data	0	0	0	

When connected to 2 Element (DELTA or 3-wire) systems, the Per-Element quantities may have no direct physical meaning. All registers are available in M650/M651 (although some don't apply to B3), registers available in M350 A3 or V3 are indicated under Meter.

Copyright 2011 Bitronics LLC

Copyright 2011 Bitronics LLC

APPENDIX C MODBUS CONFIGURATION PARAMETERS

Configuration Parameter	Description	Default or Options
Modbus Session		
Session	The number of the session you are configuring	Option of 1 – 8, default is 1
Type	The session type	Option RTU, TCP, default is RTU
Slave address	The source address for the selected session	Default is 1
Points List	The register set to be used for the meter. The options are the Bitronics Legacy Fixed (BiLF) 12-bit or 16-bit.	Default is BiLF12
Tag Register	Location of the tag register	Default is 0
Receive Frame Timeout (ms)	Maximum amount of time (ms) to wait for a complete frame after receiving valid frame sync characters	Default is 4000 ms
Serial		
Inter-Character Timeout (ms)	The amount of time (ms) of silence at the end of a frame before timeout. At 9600 baud, 4 ms is 4 character times.	Default is 4 ms.
Delimiter 1	Delimiter 1 and 2 are used only with Modbus ASCII for carriage return and line feed.	Default is 13
Delimiter 2	Delimiter 1 and 2 are used only with Modbus ASCII for carriage return and line feed.	Default is10
Legacy RTU Accommodation Factors	For this and all of the remaining items in this section, these are the maximum allowable values. Some older RTUs may not be able to accommodate the maximum and the settings can be reduced to work with those RTUs.	
Max Holding Regs to Read		Default is 125
Max Holding Regs to Write		Default is 125
TCP/IP		
IP Address	The IP address of the master (a value of 0 allows any IP address to connect)	Default is 0.0.0.0
IED Listen Port	The port that the 50 Series IED listens on.	Default is 502

Copyright 2011 Bitronics LLC

Revision	Date	Changes	By
A	3/15/10	Original	E. DeMicco
B	4/15/10	Update for email address change	E. DeMicco
C	5/31/10	Added M350 references and added registers 40115 - 40159 BiLF16	E. DeMicco
D	2/14/11	Added M651 and custom register set references	E. DeMicco
E	9/08/11	Added Primary Units	E. DeMicco

 Copyright 2011 Bitronics LLC

Bitronics LLC, 261 Brodhead Road, Bethlehem, PA. 18017
(610) 997-5100 Fax (610) 997-5450
www.novatechweb.com/bitronics